No Sensitivity Testing

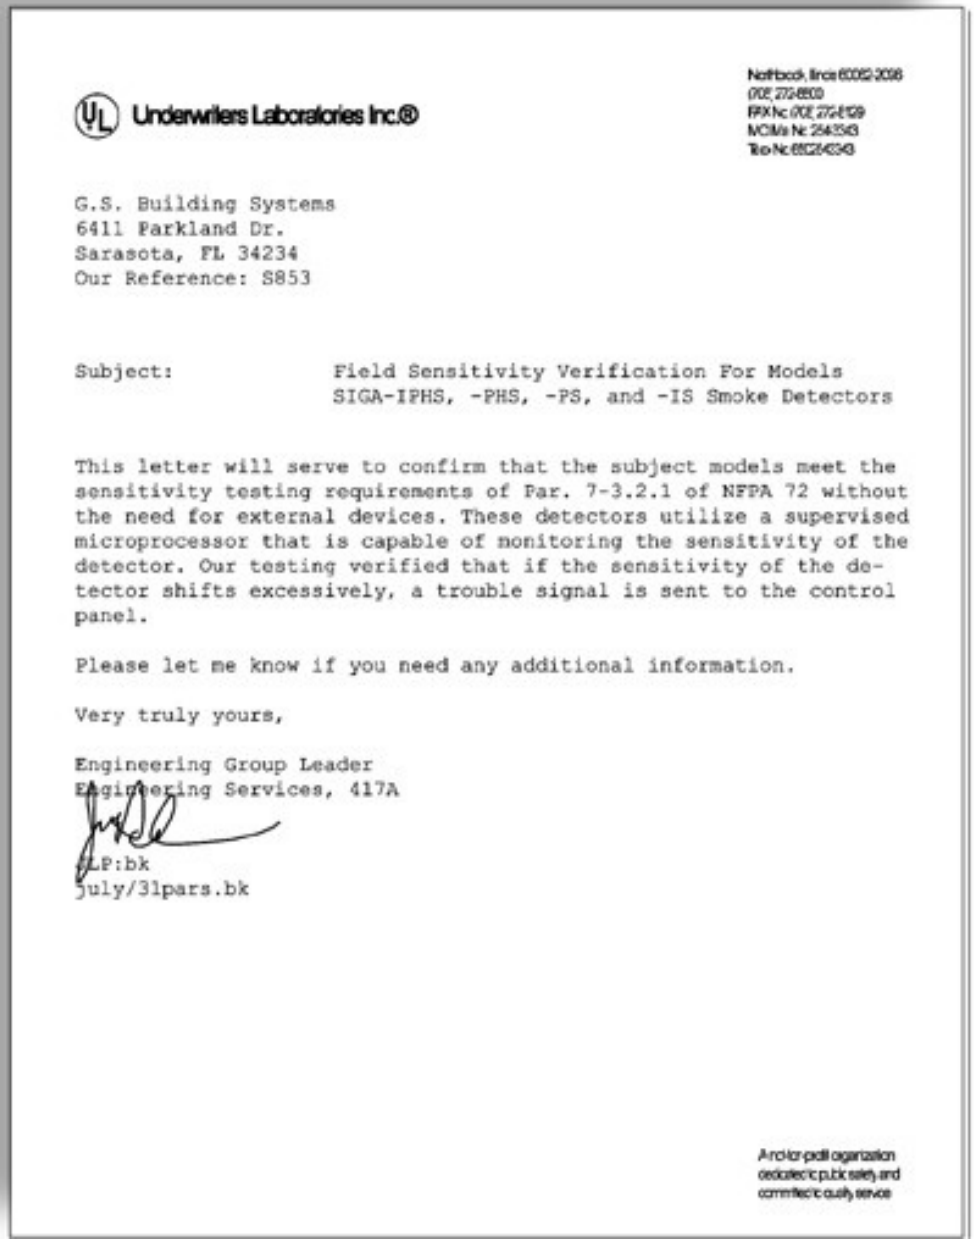

Underwriters Laboratories Inc.®

Northbrook, Illinois 60062-2096
(708) 272-8800
FAX No. (708) 272-8129
MCI Id No. 2563563
Telex No. 6852434343

G.S. Building Systems
6411 Parkland Dr.
Sarasota, FL 34234
Our Reference: S853

Subject: Field Sensitivity Verification For Models SIGA-IPHS, -PHS, -PS, and -IS Smoke Detectors

This letter will serve to confirm that the subject models meet the sensitivity testing requirements of Par. 7-3.2.1 of NFPA 72 without the need for external devices. These detectors utilize a supervised microprocessor that is capable of monitoring the sensitivity of the detector. Our testing verified that if the sensitivity of the detector shifts excessively, a trouble signal is sent to the control panel.

Please let me know if you need any additional information.

Very truly yours,

Engineering Group Leader
Engineering Services, 417A

JLP:bk
July/31pars.bk

A not-for-profit organization dedicated to public safety and committed to quality service